

Voyent Alert! - RDCK: Flushing/Maintenance Notice

May 03 2021 8:58am



Zone - Woodland Heights Water System - Water System Maint...

15 Estimated Notifications

iOS	Android	SMS	Email	Phone Call
6	3	6	0	0

Description


Effective **May 5, 2021**, operators will be performing **flushing and valve exercising** on the **Woodland Heights** Water System. Users may experience water outages on **May 5, 2021** from **9:00 am to 4:00 pm**.


Instructions

The RDCK requests that users limit water use during the time outlined for maintenance, and to flush water through a tap after maintenance has been completed until it is clear and odourless.

Additional Information

We apologize for any inconvenience this might cause, and appreciate your cooperation and patience during this time. For more information contact the RDCK (250) 352-8192 or 1-800-268-7325 ext. 8192, or visit our website at www.rdck.ca/water.

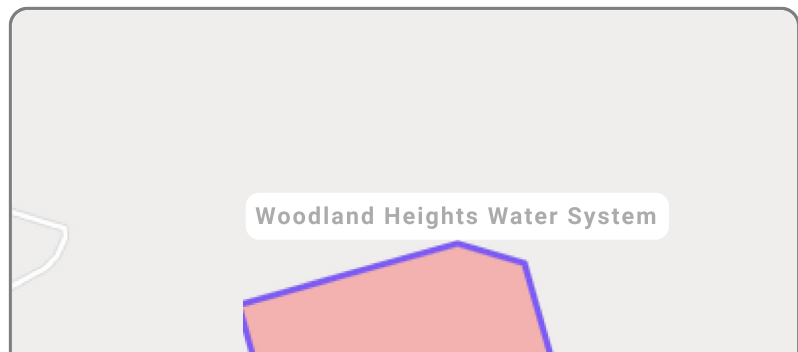

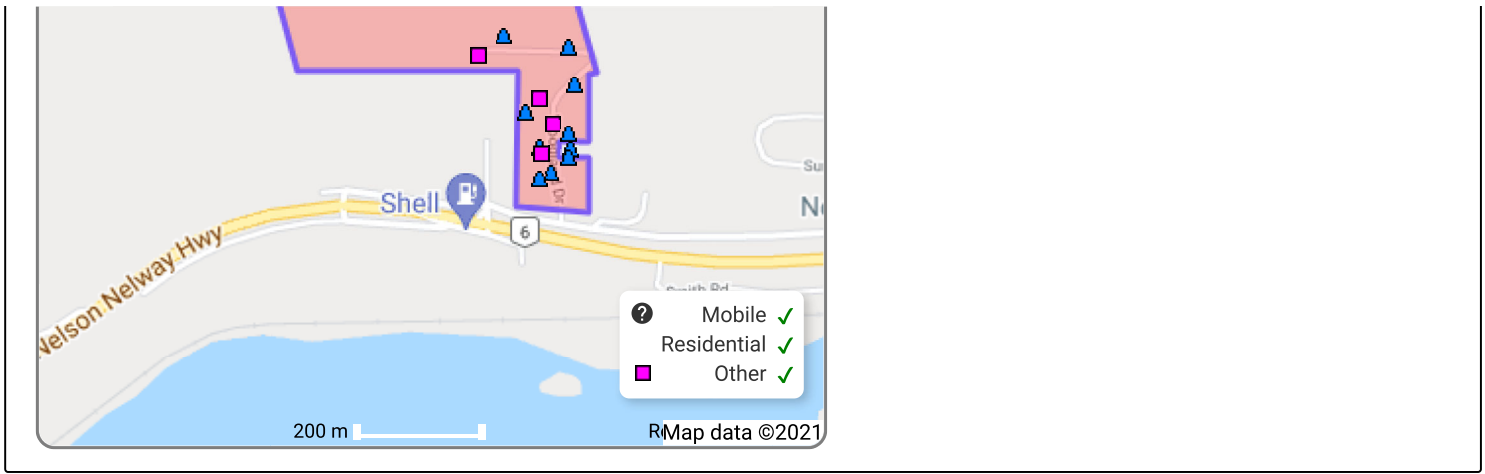



Zone - Entire Region - Water System Maintenance

9 Estimated Notifications

iOS	Android	SMS	Email	Phone Call	Facebook	Twitter
0	0	5	4	0	X	X

Description

Effective **May 5, 2021**, operators will be performing **flushing and valve exercising** on the **Woodland Heights** Water System. Users may experience water outages on **May 5, 2021** from **9:00 am to 4:00 pm**.

Instructions

The RDCK requests that users limit water use during the time outlined for maintenance, and to flush water through a tap after maintenance has been completed until it is clear and odourless.

Additional Information

We apologize for any inconvenience this might cause, and appreciate your cooperation and patience during this time. For more information contact the RDCK (250) 352-8192 or 1-800-268-7325 ext. 8192, or visit our website at www.rdck.ca/water.

